



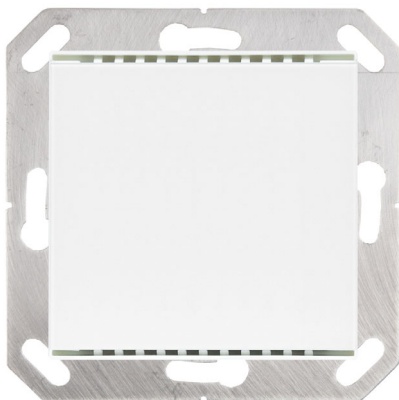

KNX T-UP gl

Temperature Sensor

Item numbers 70631 (black), 70632 (pure white)

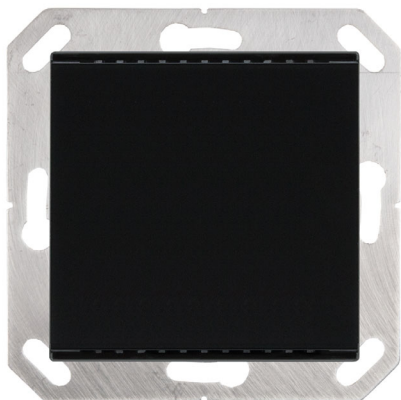

1. Safety and operating instructions	3
2. Description	3
3. Commissioning	4
3.1. Addressing the equipment	4
4. Transfer protocol	5
4.1. List of all communications objects	5
5. Parameter setting	11
5.1. Behaviour on power failure/ restoration of power	11
5.2. General settings	11
5.3. Temperature value	12
5.4. Temperature threshold values	12
5.4.1. Threshold value 1, 2, 3	12
5.4.1.1. Threshold value	12
5.4.1.2. Switching output	13
5.4.1.3. Block	14
5.5. Temperature PI control	15
5.5.0.1. General control	15
5.5.1. General set point values	17
5.5.1.1. Set point Comfort	17
5.5.1.2. Standby setpoint	18
5.5.1.3. Eco setpoint	18
5.5.1.4. Setpoint values for frost/heat protection (building protection)	19
5.5.1.5. General control variables	19
5.5.2. Heating control level 1/2	20
5.5.3. Cooling control level 1/2	22
5.6. Variable comparator	24
5.6.1. Control variable comparator 1/2	24
5.7. Logic	25
5.7.0.1. AND logic	25
5.7.0.2. OR logic	25
5.7.1. AND logic 1-4 and OR logic outputs 1-4	25
5.7.1.1. Block	27
5.7.2. Connection inputs of the AND logic	27
5.7.3. Connection inputs of the OR logic	28

This manual is amended periodically and will be brought into line with new software releases. The change status (software version and date) can be found in the contents footer. If you have a device with a later software version, please check **www.elsner-elektronik.de** in the menu area "Service" to find out whether a more up-to-date version of the manual is available.

Clarification of signs used in this manual



Safety advice.



Safety advice for working on electrical connections, components, etc.

DANGER!

... indicates an immediately hazardous situation which will lead to death or severe injuries if it is not avoided.

WARNING!

... indicates a potentially hazardous situation which may lead to death or severe injuries if it is not avoided.

CAUTION!

... indicates a potentially hazardous situation which may lead to trivial or minor injuries if it is not avoided.



ATTENTION! ... indicates a situation which may lead to damage to property if it is not avoided.

ETS

In the ETS tables, the parameter default settings are marked by underlining.

1. Safety and operating instructions



Installation, testing, operational start-up and troubleshooting should only be performed by an authorised electrician.



CAUTION! **Live voltage!**

There are unprotected live components inside the device.

- Inspect the device for damage before installation. Only put undamaged devices into operation.
 - Comply with the locally applicable directives, regulations and provisions for electrical installation.
 - Immediately take the device or system out of service and secure it against unintentional switch-on if risk-free operation is no longer guaranteed.
-

Use the device exclusively for building automation and observe the operating instructions. Improper use, modifications to the device or failure to observe the operating instructions will invalidate any warranty or guarantee claims.

Operate the device only as a fixed-site installation, i.e. only in assembled condition and after conclusion of all installation and operational start-up tasks, and only in the surroundings designated for it.

Elsner Elektronik is not liable for any changes in norms and standards which may occur after publication of these operating instructions.

For information on installation, maintenance, disposal, scope of delivery and technical data, please refer to the installation instructions.

2. Description

The **Sensor KNX T-UP gl** measures the room temperature. The indoor sensor can receive an external measured value via the bus and process it with own data to an overall temperature value (mixed value).

The **KNX T-UP gl** provides adjustable threshold values. The threshold value outputs and further communication objects can be linked by AND and OR logic gates. Additionally, an integrated actuating variable comparator can compare and output values that are received via communication objects. The sensor has integrated PI controller for a heating/cooling system.

The device is completed with a frame of the switching series installed in the building and thus merges with the interior.

Functions:

- Measurement of **temperature**
- **Mixed values** from own measured value and external values (proportions can be set in percentage)

- **PI controller for heating** (one or two step) and **cooling** (one or two step) depending on temperature. Control according to separate target values or basic target temperature
- **Threshold values** can be adjusted per parameter or via communication objects: 3 × temperature
- **4 AND and 4 OR logic gates** with each 4 inputs. Every switching incident as well as 16 logic inputs in the form of communication objects, may be used as inputs for the logic gates. The output of each gate may optionally be configured as 1 bit or 2 × 8 bits
- **2 actuating variable comparators** for output of minimum, maximum or average values. Each with 5 inputs (for values received via communication objects)

3. Commissioning

Configuration is made using the KNX software as of ETS 5. The **product file** can be downloaded from the ETS online catalogue and the Elsner Elektronik website on www.elsner-elektronik.de in the "Service" menu.

After the bus voltage has been applied, the device will enter an initialisation phase lasting approx. 6 seconds. During this phase no information can be received or sent via the bus.

3.1. Addressing the equipment

The equipment is delivered with the bus address 15.15.255. Another address can be programmed using the ETS.

For this purpose there is a button with a control LED on the unit.

4. Transfer protocol

Units:

Temperatures in degrees Celsius

Air humidity in %

Absolute air humidity in g/kg and/or g/m³

Variables in %

4.1. List of all communications objects

Abbreviation flags:

C Communication

R Read

W Write

T Transfer

U Update

No	Text	Function	Flags	DPT Typ	Size
0	Software version	readable	R-CT	[217.1] DPT_Version	2 Bytes
1	Temperature sensor malfunction	Output	R-CT	[1.1] DPT_Switch	1 Bit
3	External measured value for temperature	Input	-RC-	[9.1] DPT_- Value_Temp	2 Bytes
4	Internal measured value for temperature	Output	R-CT	[9.1] DPT_- Value_Temp	2 Bytes
5	Total measured value for temperature	Output	R-CT	[9.1] DPT_- Value_Temp	2 Bytes
6	Request min./max. temperature measured value	Input	-RC-	[1.17] DPT_Trigger	1 Bit
7	Minimum measured value for temperature	Output	R-CT	[9.1] DPT_- Value_Temp	2 Bytes
8	Maximum measured value for temperature	Output	R-CT	[9.1] DPT_- Value_Temp	2 Bytes
9	Reset min./max. measured value for temperature	Input	-RC-	[1.17] DPT_Trigger	1 Bit
10	Temp. thresholdV 1: Absolute value	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
11	Temp. thresholdV 1: (1:+ 0:-)	Input	-RC-	[1.2] DPT_Boo1	1 Bit

No	Text	Function	Flags	DPT Typ	Size
12	Temp. thresholdV 1: Switching delay from 0 to 1	Input	-RC-	[9.010] DPT_Value_Time	2 Bytes
13	Temp. thresholdV 1: Switching delay from 1 to 0	Input	-RC-	[9.010] DPT_Value_Time	2 Bytes
14	Temp. thresholdV 1: Switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
15	Temp. thresholdV 1: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
16	Temp. thresholdV 2: Absolute value	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
17	Temp. thresholdV 2: (1:+ 0:-)	Input	-RC-	[1.2] DPT_Bool	1 Bit
18	Temp. thresholdV 2: Switching delay from 0 to 1	Input	-RC-	[9.010] DPT_Value_Time	2 Bytes
19	Temp. thresholdV 2: Switching delay from 1 to 0	Input	-RC-	[9.010] DPT_Value_Time	2 Bytes
20	Temp. thresholdV 2: Switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
21	Temp. thresholdV 2: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
22	Temp. thresholdV 3: Absolute value	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
23	Temp. thresholdV 3: (1:+ 0:-)	Input	-RC-	[1.2] DPT_Bool	1 Bit
24	Temp. thresholdV 3: Switching delay from 0 to 1	Input	-RC-	[9.010] DPT_Value_Time	2 Bytes
25	Temp. thresholdV 3: Switching delay from 1 to 0	Input	-RC-	[9.010] DPT_Value_Time	2 Bytes
26	Temp. thresholdV 3: Switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
27	Temp. thresholdV 3: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
29	Temp.control: HVAC mode (priority 1)	Input	-RC-	[20.102] DPT_HVACMode	1 Byte
30	Temp.control: HVAC mode (priority 2)	Input / Output	RWCT	[20.102] DPT_HVACMode	1 Byte
31	Temp.control: Mode frost/heat protection activ.	Input / Output	RWCT	[1.1] DPT_Switch	1 Bit
32	Temp.control: Block (On when value = 1)	Input	-RC-	[1.1] DPT_Switch	1 Bit
33	Temp.control: Current setpoint	Output	R-CT	[9.1] DPT_- Value_Temp	2 Bytes

No	Text	Function	Flags	DPT Typ	Size
34	Temp.control: Switch. (Heating = 0 Cooling = 1)	Input	-RC-	[1.1] DPT_Switch	1 Bit
35	Temp.control: Setpoint Comfort heating	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
36	Temp.control: Setpoint Comfort heat.(1:+ 0:-)	Input	-RC-	[1.1] DPT_Switch	1 Bit
37	Temp.control: Setpoint Comfort cooling	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
38	Temp.control: Setpoint Comfort cool.(1:+ 0:-)	Input	-RC-	[1.1] DPT_Switch	1 Bit
39	Temp.control: Basic 16-bit setpoint shift	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
40	Temp.control: Setpoint Standby heating	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
41	Temp.control: Setpoint Standby heat.(1:+ 0:-)	Input	-RC-	[1.1] DPT_Switch	1 Bit
42	Temp.control: Setpoint Standby cooling	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
43	Temp.control: Setpoint Standby cool. (1:+ 0:-)	Input	-RC-	[1.1] DPT_Switch	1 Bit
44	Temp.control: Setpoint Eco heating	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
45	Temp.control: Setpoint Eco heating (1:+ 0:-)	Input	-RC-	[1.1] DPT_Switch	1 Bit
46	Temp.control: Setpoint Eco cooling	Input / Output	RWCT	[9.1] DPT_- Value_Temp	2 Bytes
47	Temp.control: Setpoint Eco cooling (1:+ 0:-)	Input	-RC-	[1.1] DPT_Switch	1 Bit
48	Temp.control: Control variable heating (level 1)	Output	R-CT	[5.1] DPT_Scaling	1 Byte
49	Temp.control: Control variable heating (level 2)	Output	R-CT	[5.1] DPT_Scaling	1 Byte
50	Temp.control: Control variable cooling (level 1)	Output	R-CT	[5.1] DPT_Scaling	1 Byte
51	Temp.control: Control variable cooling (level 2)	Output	R-CT	[5.1] DPT_Scaling	1 Byte
52	Temp.control: Status Heat. level 1 (1=ON 0=OFF)	Output	R-CT	[1.1] DPT_Switch	1 Bit

No	Text	Function	Flags	DPT Typ	Size
53	Temp.control: Status Heat. level 2 (1=ON 0=OFF)	Output	R-CT	[1.1] DPT_Switch	1 Bit
54	Temp.control: Status Cool. level 1 (1=ON 0=OFF)	Output	R-CT	[1.1] DPT_Switch	1 Bit
55	Temp.control: Status Cool. level 2 (1=ON 0=OFF)	Output	R-CT	[1.1] DPT_Switch	1 Bit
56	Temp.control: Comfort extension status	Input / Output	RWCT	[1.1] DPT_Switch	1 Bit
57	Temp.control: Comfort Extension time	Input	RWCT	[7.5] DPT_TimePeriodSec	2 Bytes
58	Temperature control: Variable for 4/6-way valve	Output	R-CT	[5.1] DPT_Scaling	1 Byte
131	CO2 control: Act. variable ventilation (1.stage)	Output	R-CT	[5.1] DPT_Scaling	1 Byte
133	CO2 control: Status ventilation (1=ON 0=OFF)	Output	R-CT	[1.1] DPT_Switch	1 Bit
134	CO2 control: Status ventilation 2 (1=ON 0=OFF)	Output	R-CT	[1.1] DPT_Switch	1 Bit
135	Actuating variable comparator 1: Input 1	Input	-RC-	[5.1] DPT_Scaling	1 Byte
136	Actuating variable comparator 1: Input 2	Input	-RC-	[5.1] DPT_Scaling	1 Byte
137	Actuating variable comparator 1: Input 3	Input	-RC-	[5.1] DPT_Scaling	1 Byte
138	Actuating variable comparator 1: Input 4	Input	-RC-	[5.1] DPT_Scaling	1 Byte
139	Actuating variable comparator 1: Input 5	Input	-RC-	[5.1] DPT_Scaling	1 Byte
140	Actuating variable comparator 1: Output	Output	R-CT	[5.1] DPT_Scaling	1 Byte
141	Actuating variable comparator 1: Block	Output	-RC-	[1.2] DPT_Bool	1 Bit
142	Actuating variable comparator 2: Input 1	Input	-RC-	[5.1] DPT_Scaling	1 Byte
143	Actuating variable comparator 2: Input 2	Input	-RC-	[5.1] DPT_Scaling	1 Byte
144	Actuating variable comparator 2: Input 3	Input	-RC-	[5.1] DPT_Scaling	1 Byte
145	Actuating variable comparator 2: Input 4	Input	-RC-	[5.1] DPT_Scaling	1 Byte
146	Actuating variable comparator 2: Input 5	Input	-RC-	[5.1] DPT_Scaling	1 Byte

No	Text	Function	Flags	DPT Typ	Size
147	Actuating variable comparator 2: Output	Output	R-CT	[5.1] DPT_Scaling	1 Byte
148	Actuating variable comparator 2: Block	Output	-RC-	[1.2] DPT_Bool	1 Bit
149	AND logic 1: 1 bit switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
150	AND logic 1: 8 bit output A	Output	R-CT	[5] 5.xxx	1 Byte
151	AND logic 1: 8 bit output B	Output	R-CT	[5] 5.xxx	1 Byte
152	AND logic 1: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
153	AND logic 2: 1 bit switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
154	AND logic 2: 8 bit output A	Output	R-CT	[5] 5.xxx	1 Byte
155	AND logic 2: 8 bit output B	Output	R-CT	[5] 5.xxx	1 Byte
156	AND logic 2: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
157	AND logic 3: 1 bit switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
158	AND logic 3: 8 bit output A	Output	R-CT	[5] 5.xxx	1 Byte
159	AND logic 3: 8 bit output B	Output	R-CT	[5] 5.xxx	1 Byte
160	AND logic 3: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
161	AND logic 4: 1 bit switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
162	AND logic 4: 8 bit output A	Output	R-CT	[5] 5.xxx	1 Byte
163	AND logic 4: 8 bit output B	Output	R-CT	[5] 5.xxx	1 Byte
164	AND logic 4: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
181	OR logic 1: 1 bit switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
182	OR logic 1: 8 bit output A	Output	R-CT	[5] 5.xxx	1 Byte
183	OR logic 1: 8 bit output B	Output	R-CT	[5] 5.xxx	1 Byte
184	OR logic 1: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit

No	Text	Function	Flags	DPT Typ	Size
185	OR logic 2: 1 bit switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
186	OR logic 2: 8 bit output A	Output	R-CT	[5] 5.xxx	1 Byte
187	OR logic 2: 8 bit output B	Output	R-CT	[5] 5.xxx	1 Byte
188	OR logic 2: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
189	OR logic 3: 1 bit switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
190	OR logic 3: 8 bit output A	Output	R-CT	[5] 5.xxx	1 Byte
191	OR logic 3: 8 bit output B	Output	R-CT	[5] 5.xxx	1 Byte
192	OR logic 3: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
193	OR logic 4: 1 bit switching output	Output	R-CT	[1.1] DPT_Switch	1 Bit
194	OR logic 4: 8 bit output A	Output	R-CT	[5] 5.xxx	1 Byte
195	OR logic 4: 8 bit output B	Output	R-CT	[5] 5.xxx	1 Byte
196	OR logic 4: Switching output block	Input	-RC-	[1.2] DPT_Bool	1 Bit
200	Logic input 1	Input	-RC-	[1.2] DPT_Bool	1 Bit
201	Logic input 2	Input	-RC-	[1.2] DPT_Bool	1 Bit
202	Logic input 3	Input	-RC-	[1.2] DPT_Bool	1 Bit
203	Logic input 4	Input	-RC-	[1.2] DPT_Bool	1 Bit
204	Logic input 5	Input	-RC-	[1.2] DPT_Bool	1 Bit
205	Logic input 6	Input	-RC-	[1.2] DPT_Bool	1 Bit
206	Logic input 7	Input	-RC-	[1.2] DPT_Bool	1 Bit
207	Logic input 8	Input	-RC-	[1.2] DPT_Bool	1 Bit
208	Logic input 9	Input	-RC-	[1.2] DPT_Bool	1 Bit
209	Logic input 10	Input	-RC-	[1.2] DPT_Bool	1 Bit

No	Text	Function	Flags	DPT Typ	Size
210	Logic input 11	Input	-RC-	[1.2] DPT_Bool	1 Bit
211	Logic input 12	Input	-RC-	[1.2] DPT_Bool	1 Bit
212	Logic input 13	Input	-RC-	[1.2] DPT_Bool	1 Bit
213	Logic input 14	Input	-RC-	[1.2] DPT_Bool	1 Bit
214	Logic input 15	Input	-RC-	[1.2] DPT_Bool	1 Bit
215	Logic input 16	Input	-RC-	[1.2] DPT_Bool	1 Bit

5. Parameter setting

5.1. Behaviour on power failure/ restoration of power

Behaviour following a failure of the bus power supply:

The device sends nothing.

Behaviour on bus restoration of power and following programming or reset:

The device sends all outputs according to their send behaviour set in the parameters with the delays established in the "General settings" parameter block.

5.2. General settings

Set the basic data transfer characteristics and select whether or not malfunction objects should be sent.

Send delay after power-up and programming for:	
Measured values	<u>5 s</u> • ... • 2 h
Threshold values and switching outputs	<u>5 s</u> • ... • 2 h
Controller objects	5 s • <u>10 s</u> • ... • 2 h
Logic outputs	5 s • <u>10 s</u> • ... • 2 h
Maximum telegram quota	<ul style="list-style-type: none"> • 1 message per second • ... • <u>5 messages per second</u> • ... • 20 messages per second
Use temperature malfunction object	Yes • <u>No</u>

5.3. Temperature value

When **measuring temperature**, the self-heating of the device is considered by the electronics. The heating is compensated for in the device.

Use **Offsets** to adjust the readings to be sent.

Permanent measurement variations can be corrected in this way.

Offset in 0,1°C	-50...50; <u>0</u>
-----------------	--------------------

The unit can calculate a **mixed value** from its own reading and an external value. Set the mixed value calculation if desired. If an external value is used, all of the following settings are referred to the total value.

Use external reading	Yes • <u>No</u>
Ext. Reading proportion of the total reading	5% • 10% • ... • <u>50%</u> • ... • 100%
All of the following settings are referred to the total value.	
Send internal and total reading	<ul style="list-style-type: none"> • <u>never</u> • periodically • on change • on change and periodically
From change of (if sent on change)	<u>0,1°C</u> • 0,2°C • 0,5°C • ... • 5,0°C
Send cycle (if sent periodically)	<u>5 s</u> • 10 s • ... • 2 h

The **minimum and maximum readings** can be saved and sent to the bus. Use the „Reset temperature min/max. value“ objects to reset the values to the current readings. The values are not retained after a reset.

Use minimum/maximum value	Yes • <u>No</u>
---------------------------	-----------------

5.4. Temperature threshold values

Activate the required temperature threshold values. The menus for setting the threshold values are displayed.

Use threshold value 1/2/3	Yes • <u>No</u>
---------------------------	-----------------

5.4.1. Threshold value 1, 2, 3

Threshold value

Set, in which cases **threshold values** received via object are to be retained. The parameter is only taken into consideration if the setting via object is activated below. Please note that the setting "After power supply restoration and programming" should not be used for the initial start-up, as the factory settings are always used until the first communication (setting via objects is ignored).

Set the threshold value directly in the application program using parameters, or define them via the bus using a communication object.

Threshold value setting via parameter:

Set the threshold values and hysteresis directly.

Threshold value setting via	Parameter • Communication objects
Threshold value in 0.1°C	-300 ... 800; <u>200</u>

Threshold value setting via a communication object:

Define, how the threshold value is to be received from the bus. Basically, a new value can be received, or simply a command to increase or decrease.

During initial commissioning, a threshold value must be defined, which will be valid until the first communication with a new threshold value. For units which have already been taken into service, the last communicated threshold value can be used. Basically, a temperature range is given, in which the threshold value can be changed (object value limit).

A set threshold value will be retained until a new value or a change is transferred. The current value is saved, so that it is retained in the event of a power supply failure and will be available once the power supply is restored.

Threshold value setting via	Parameter • Communication objects
The value communicated last shall be maintained	<ul style="list-style-type: none"> • <u>never</u> • after power supply restoration • after power supply restoration and programming
Start threshold value in 0.1°C valid until first communication	-300 ... 800; <u>200</u>
Object value limit (min) in 0.1°C	<u>-300</u> ...800
Object value limit (max) in 0.1°C	-300... <u>800</u>
Type of threshold value change	<u>Absolute value</u> • Increase/decrease
Increment (upon increase/decrease change)	0,1 °C • ... • 5°C, <u>1°C</u>

Set the **hysteresis** independent of the type of threshold value specification.

Hysteresis in % of the threshold value	0 ... 50; <u>20</u>
----------------------------------------	---------------------

Switching output

Set the behaviour of the switching output when a threshold value is exceeded/undercut. The output switching delay can be set using objects or directly as a parameter.

When the following conditions apply, the output is (TV = Threshold value)	<ul style="list-style-type: none"> • TV above = 1 TV - hyst. below = 0 • $\overline{\text{TV}}$ above = 0 TV - hyst. below = 1 • TV below = 1 TV + hyst. above = 0 • TV below = 0 TV + hyst. above = 1
Delays can be set via objects (in seconds)	<u>No</u> • Yes

Switching delay from 0 to 1 <i>(If delay can be set via objects: valid until 1st communication)</i>	<u>None</u> • 1 s • 2 s • 5 s • 10 s • ... • 2 h
Switching delay from 1 to 0 <i>(If delay can be set via objects: valid until 1st communication)</i>	<u>None</u> • 1 s • 2 s • 5 s • 10 s • ... • 2 h
Switching output sends	<ul style="list-style-type: none"> • <u>on change</u> • on change to 1 • on change to 0 • on change and periodically • on change to 1 and periodically • on change to 0 and periodically
Cycle <i>(only if sending periodically is selected)</i>	<u>5 s</u> • 10 s • 30 s ... • 2 h

Block

The switching output can be blocked using an object.

Use switching output block	<u>No</u> • Yes
----------------------------	-----------------

If the block is activated, define specifications here for the behaviour of the output when blocked.

Analysis of the blocking object	<ul style="list-style-type: none"> • <u>At value 1: block</u> <u>At value 0: release</u> • <u>At value 0: block</u> <u>At value 1: release</u>
Blocking object value before 1st communication	<u>0</u> • 1
Behaviour of the switching output	
On block	<ul style="list-style-type: none"> • <u>Do not send message</u> • send 0 • send 1
On release <i>(with 2 seconds release delay)</i>	[Dependent on the "Switching output sends" setting]

The behaviour of the switching output on release is dependent on the value of the parameter "Switching output sends" (see "Switching output")

Switching output sends on change	<ul style="list-style-type: none"> • Do not send message • Send switching output status
Switching output sends on change to 1	<ul style="list-style-type: none"> • Do not send message • if switching output = 1 → send 1
Switching output sends on change to 0	<ul style="list-style-type: none"> • Do not send message • if switching output = 0 → send 0
Switching output sends on change and periodically	Send switching output status
Switching output sends on change to 1 and periodically	if switching output = 1 → send 1
Switching output sends on change to 0 and periodically	if switching output = 0 → send 0

5.5. Temperature PI control

Activate the control if you want to use it.

Use control	<u>No</u> • Yes
-------------	-----------------

General control

Set, in which cases **setpoint values and extension time** received via object are to be retained. The parameter is only taken into consideration if the setting via object is activated below. Please note that the setting "After power supply restoration and programming" should not be used for the initial start-up, as the factory settings are always used until the 1st communication (setting via objects is ignored).

For an adequate regulation of the indoor temperature, comfort, standby, eco and building protection modes may be used.

Comfort when present,

Standby during short absences,

Eco as a night-time mode and

Frost/heat protection (building protection) during longer absences.

The settings for the temperature control include the set point temperatures for the individual modes. Objects are used to determine which mode is to be selected. A change of mode may be triggered manually or automatically (e.g. by a timer, window contact).

The **mode** may be switched with two 8 bit objects of different priority. Objects

„... HVAC mode (Prio 2)“ for switching in everyday operation and

„... HVAC mode (Prio 1)“ for central switching with higher priority.

The objects are coded as follows:

0 = Auto

1 = Comfort

2 = Standby

3 = Eco

4 = Building Protection

Alternatively, you can use three objects, with one object switching between eco and standby mode and the two others activating comfort mode and frost/heat protection mode respectively. The comfort object blocks the eco/standby object, and the frost/heat protection object has the highest priority. Objects

„... Mode (1: Eco, 0: Standby)“,

„... comfort activation mode“ and

„... frost/heat protection activation mode“

Switch mode via	<ul style="list-style-type: none"> • two 8 Bit objects (HVAC Modes) • three 1 bit objects
-----------------	-------------------------------------------------------------------------------------------------------------------

Select the **mode to be activated after reset** (e.g. power failure, reset of the line via the bus) (Default).

Then configure a temperature control **block** via the blocking object.

Mode after reset	<ul style="list-style-type: none"> • <u>Comfort</u> • <u>Standby</u> • <u>Eco</u> • <u>Building protection</u>
Behaviour of the blocking object with value	<ul style="list-style-type: none"> • <u>1 = Block 0 = release</u> • <u>0 = block 1 = release</u>
Blocking object value before 1st communication	<u>0</u> • 1

Specify when the current **control variables** of the controller are to be **sent** to the bus. Periodic sending is safer, in case a message does not reach a recipient. You may also set up periodical monitoring by the actuator with this setting.

Send control variable	<ul style="list-style-type: none"> • <u>on change</u> • <u>on change and periodically</u>
from change (in % absolute)	1...10; <u>2</u>
Cycle (if sent periodically)	5 s • ... • <u>5 min</u> • ... • 2 h

The **status object** reports the current status of the control variables (0% = OFF, >0% = ON) and may for example be used for visualisation, or to switch off the heating pump as soon as the heating is switched off.

Send status objects	<ul style="list-style-type: none"> • <u>on change</u> • <u>on change to 1</u> • <u>on change to 0</u> • <u>on change and periodically</u> • <u>on change to 1 and periodically</u> • <u>on change to 0 and periodically</u>
Cycle (if sent periodically)	5 s • ... • <u>5 min</u> • ... • 2 h

Then define the **type of control**. Heating and/or cooling may be controlled in two levels.

Type of control	<ul style="list-style-type: none"> • <u>Single level heating</u> • <u>Dual-level heating</u> • <u>Single-level cooling</u> • <u>Single-level heating + single-level cooling</u> • <u>Dual-level heating + single-level cooling</u> • <u>Dual-level heating + dual-level cooling</u>
-----------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

General set point values

You may enter separate set point values for each mode or use the comfort set point as a basic value.

If you are using the controls for both heating *and* cooling, you may also select the setting "separately with switching object". Systems used for cooling in the summer and for heating in the winter can thus be switched from one to the other.

If you are using the basic value, only the deviation from the comfort set point value is listed for the other modes (e. g., 2°C less for standby mode).

Preserve modified set points after mode change	No • <u>Yes</u>
Setting the nominal values	<ul style="list-style-type: none"> • <u>separate with switching object</u> • separate without switching object • with comfort set point as a basis

The grades for the set point changes is predefined. Modifications may only remain active temporarily (do not save) or remain saved even after voltage recovery (and programming). This also applies to a comfort extension.

Grading for set point changes (in 0.1 °C)	1... 50; <u>10</u>
Saving set point value(s)	not <ul style="list-style-type: none"> • <u>after voltage recovery</u> • after voltage recovery and programming

The control may be manually reset to comfort mode from eco, or night mode. This allows the user to maintain the daily nominal value for a longer time, e.g. when having guests. The duration of this comfort extension period is set. After the comfort extension period is terminated, the system returns to eco mode.

Comfort extension time in seconds (can only be activated from eco mode)	1...36000; <u>3600</u>
-------------------------------------------------------------------------	------------------------

Set point Comfort

Comfort mode is usually used for daytime mode when people are present. A starting value is defined for the comfort set point as well as a temperature range in which the nominal value may be modified.

Initial heating/cooling set point (in 0.1 °C) valid till 1st communication <i>not upon saving the set point value after programming</i>	-300...800; <u>210</u>
--------------------------------------------------------------------------------------------------------------------------------------------	------------------------

If set point values are entered separately:

Min. object value heating/cooling (in 0.1 °C)	-300...800; <u>160</u>
Max. object value heating/cooling (in 0.1 °C)	-300...800; <u>280</u>

If the comfort setpoint value is used as a basis:

If the comfort setpoint value is used as a basis, the reduction/increment of the value is set.

Starting heating/cooling setpoint (in 0.1 °C) valid until 1st communication	-300...800; <u>210</u>
Minimum base setpoint (in 0.1°C)	-300...800; <u>160</u>
Maximum base setpoint (in 0.1°C)	-300...800; <u>280</u>
Reduction by up to (in 0.1°C)	1...100; <u>50</u>
Increase by up to (in 0.1°C)	1...100; <u>50</u>

If the comfort setpoint is used as the basis without a switching object, a dead zone is specified for the control mode "heating *and* cooling" to avoid direct switching from heating to cooling.

Dead zone between heating and cooling in 0,1°C (only if both heating AND cooling are used)	1...100; <u>50</u>
-----------------------------------------------------------------------------------------------	--------------------

Standby setpoint

Standby mode is usually used for daytime mode when people are absent.

If setpoint values are entered separately:

A starting setpoint value is defined as well as a temperature range in which the setpoint value may be changed.

Starting heating setpoint (in 0.1 °C) valid until 1st communication	-300...800; <u>180</u>
Starting heating setpoint (in 0.1 °C) valid until 1st communication	-300...800; <u>240</u>
Min. object value heating/cooling (in 0.1 °C)	-300...800; <u>160</u>
Max. object value heating/cooling (in 0.1 °C)	-300...800; <u>280</u>

If the comfort setpoint value is used as a basis:

If the comfort setpoint value is used as a basis, the reduction/increment of the value is set.

Reduce heating setpoint (in 0.1°C) (for heating)	0...200; <u>30</u>
Increase cooling setpoint (in 0.1°C) (for cooling)	0...200; <u>30</u>

Eco setpoint

Eco mode is usually used for night mode.

If setpoint values are entered separately:

A starting setpoint value is defined as well as a temperature range in which the setpoint value may be changed.

Starting heating setpoint (in 0.1 °C) valid until 1st communication	-300...800; <u>160</u>
Starting cooling setpoint (in 0.1 °C) valid until 1st communication	-300...800; <u>280</u>
Min. object value heating/cooling (in 0.1 °C)	-300...800; <u>160</u>
	-300...800; <u>280</u>
Max. object value heating/cooling (in 0.1 °C)	

If the comfort setpoint value is used as a basis:

If the comfort setpoint value is used as a basis, the reduction/increment of the value is set.

Reduce heating setpoint (in 0.1°C) (for heating)	0...200; <u>50</u>
Increase cooling setpoint (in 0.1°C) (for cooling)	0...200; <u>60</u>

Setpoint values for frost/heat protection (building protection)

The building protection mode is for example used as long as windows are opened for ventilation. Setpoints for frost protection (heating) and heat protection (cooling) are determined which may not be modified from outside (no access via operating devices etc.). The building protection mode may be activated with delay, which allows you to leave the building before the controls switch to frost/heat protection mode.

Setpoint frost protection (in 0.1°C)	-300...800; <u>70</u>
Activation delay	less than • 5 s • ... • <u>5 min</u> • ... • 2 h
Setpoint heat protection (in 0.1°C)	-300...800; <u>350</u>
Activation delay	none • 5 s • ... • <u>5 min</u> • ... • 2 h

General control variables

This setting appears for the control types "Heating *and* Cooling" only. Here, you can decide whether to use a common control variable for heating and cooling. If the 2nd level has a common control variable, you also determine the control mode of the 2nd level here.

For heating and cooling	<ul style="list-style-type: none"> • <u>separate control variables are used</u> • common control variables are used for Level 1 • common control variables are used for Level 2 • common control variable are used for Level 1+2
-------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Use control variable for 4/6-way valve (only for common control variables in level 1)	<u>No</u> • Yes
Control type (for level 2 only)	<ul style="list-style-type: none"> • 2-point-control • PI control
Control variable of the 2nd Level is on (only for level 2 with 2 point controlling)	<ul style="list-style-type: none"> • <u>1 bit object</u> • 8 bit object

When using the control variable for a 4/6 way valve, the following applies:

0%...100% heating = 66%...100% control variable

OFF = 50% control variable

0%...100% cooling = 33%...0% control variable

5.5.1. Heating control level 1/2

If a heating control mode is configured, one or two setting sections for the heating levels are displayed.

In the 1st level, heating is controlled by a PI control, which allows to either enter control parameters or select predetermined applications.

In the 2nd level (therefore only in case of 2-level heating), heating is controlled via a PI or a 2-point-control.

In level 2, the setpoint difference between the two levels must also be specified, i.e. below which setpoint deviation the second level is added.

Setpoint difference between 1st and 2nd level (in 0.1°C) (for level 2)	0...100; <u>40</u>
Control type (for level 2, no common control variables)	<ul style="list-style-type: none"> • 2-point-control • PI control
Control variable is a (for level 2 with 2-point controlling, no common control variables)	<ul style="list-style-type: none"> • <u>1 bit object</u> • 8 bit object

PI control with control parameters:

This setting allows individual input of the parameters for PI control.

Control type	• PI control
Setting of the controller by	<ul style="list-style-type: none"> • Controller parameter • specified applications

Specify the deviation from the setpoint value at which the maximum control variable value is reached, i.e. the point at which maximum heating power is activated.

The reset time shows how quickly the controller responds to deviations from the setpoint value. In case of a short reset time, the control responds with a fast increase of the control variable. In case of a long reset time, the control responds somewhat less

urgently and needs longer until the necessary control variable for the setpoint value deviation is reached.

You should set the time appropriate to the heating system at this point (observe manufacturer's instructions).

Maximum control variable is reached at setpoint/actual difference of (in °C)	1... <u>5</u>
Reset time (in min.)	1...255; <u>30</u>

Now specify what should be sent when the control is blocked. Set a value greater 0 (=OFF) to receive a basic heating level, e.g. for floor heating.

On release, the control variable follows the rule again.

When blocked, the control variable shall	<ul style="list-style-type: none"> • <u>not be sent</u> • send a specific value
Value (in %) (if a value is sent)	<u>0</u> ...100

In case of a common control variable for heating and cooling, 0 is always transmitted as a fixed value.

PI control with predetermined application:

This setting provides fixed parameters for frequent applications.

Control type	• PI control
Setting of the controller by	<ul style="list-style-type: none"> • Controller parameter • specified applications
Application	<ul style="list-style-type: none"> • Warm water heating • Floor heating • Convection unit • Electric heating
Maximum control variable is reached at setpoint/actual difference of (in °C)	Warm water heating: 5 Floor heating: 5 Convection unit: 4 Electric heating: 4
Reset time (in min.)	Warm water heating: 150 Floor heating: 240 Convection unit: 90 Electric heating: 100

Now specify what should be sent when the control is blocked. Set a value greater 0 (=OFF) to receive a basic heating level, e.g. for floor heating.

On release, the control variable follows the rule again.

When blocked, the control variable shall	<ul style="list-style-type: none"> • <u>not be sent</u> • send a specific value
Value (in %) (if a value is sent)	<u>0</u> ...100

In case of a common control variable for heating and cooling, 0 is always transmitted as a fixed value.

2-point-control (only level 2):

2-point-control is used for systems which are only set to ON or OFF.

Control type <i>(is determined at a higher level for common control variables)</i>	• 2-point-control
---------------------------------------------------------------------------------------	--------------------------

Enter the hysteresis that prevents frequent on/off switching of temperatures in the threshold range.

Hysteresis (in 0.1°C)	0...100; <u>20</u>
-----------------------	--------------------

If separate control variables are used, select whether the control variable of the 2nd level is a 1 bit object (on/off) or an 8 bit object (on with percentage/off).

Control variable is a	<ul style="list-style-type: none"> • <u>1 bit object</u> • <u>8 bit object</u>
Value (in %) <i>(for 8 bit object)</i>	0... <u>100</u>

Now specify what should be sent when the control is blocked. Set a value greater 0 (=OFF) to receive a basic heating level, e.g. for floor heating. On release, the control variable follows the rule again.

When blocked, the control variable shall	<ul style="list-style-type: none"> • not be sent • send a specific value
Value (in %) <i>only if a value is sent</i>	<u>0</u> ...100

5.5.2. Cooling control level 1/2

If a cooling control mode is configured, one or two setting sections for the cooling levels are displayed.

In the 1st level, cooling is controlled by a PI control in which either control parameters can be entered or predetermined applications can be selected.

In the 2nd level (therefore only for 2-level cooling), cooling is controlled via a PI or a 2-point-control.

In level 2, the setpoint deviation between the two levels must also be specified, i.e. above which setpoint value deviation the second level is added.

Setpoint difference between 1st and 2nd level (in 0.1°C) <i>(for level 2)</i>	0...100; <u>40</u>
Control type <i>(for level 2, no common control variables)</i>	<ul style="list-style-type: none"> • 2-point-control • PI control
Control variable is a <i>(for level 2 with 2-point controlling, no common control variables)</i>	<ul style="list-style-type: none"> • <u>1 bit object</u> • <u>8 bit object</u>

PI control with control parameters:

This setting allows individual input of the parameters for PI control.

Control type	• PI control
Setting of the controller by	• Controller parameter • specified applications

Specify the deviation from the setpoint value which reaches maximum variable value, i.e. the point at which maximum cooling power is activated.

The reset time shows how quickly the controller responds to deviations from the setpoint value. In case of a short reset time, the control responds with a fast increase of the control variable. In case of a long reset time, the control responds somewhat less urgently and needs longer until the necessary control variable for the setpoint value deviation is reached. You should set the time appropriate to the cooling system at this point (observe manufacturer's instructions).

Maximum control variable is reached at setpoint/actual difference of (in °C)	1... <u>5</u>
Reset time (in min.)	1...255; <u>30</u>

Now specify what should be sent when the control is blocked.

On release, the control variable follows the rule again.

When blocked, the control variable shall	• <u>not be sent</u> • send a specific value
Value (in %) (if a value is sent)	<u>0</u> ...100

In case of a common control variable for heating and cooling, 0 is always transmitted as a fixed value.

PI control with predetermined application:

This setting provides fixed parameters for a cooling ceiling

Control type	• PI control
Setting of the controller by	• Controller parameter • specified applications
Application	• Cooling ceiling
Maximum control variable is reached at setpoint/actual difference of (in °C)	Cooling ceiling: 5
Reset time (in min.)	Cooling ceiling: 30

Now specify what should be sent when the control is blocked.

On release, the control variable follows the rule again.

When blocked, the control variable shall	• not be sent • send a specific value
Value (in %) (if a value is sent)	<u>0</u> ...100

2-point-control (only level 2):

2-point-control is used for systems which are only set to ON or OFF.

Control type <i>is determined at a higher level for common variables</i>	• 2-point-control
-----------------------------------------------------------------------------	--------------------------

Enter the hysteresis that prevents frequent on/off switching of temperatures in the threshold range.

Hysteresis (in 0.1°C)	0...100; <u>20</u>
-----------------------	--------------------

If separate control variables are used, select whether the control variable of the 2nd level is a 1 bit object (on/off) or an 8 bit object (on with percentage/off).

Control variable is a	<ul style="list-style-type: none"> • <u>1 bit object</u> • 8 bit object
Value (in %) <i>(for 8 bit object)</i>	0... <u>100</u>

Now specify what should be sent when the control is blocked.

On release, the control variable follows the rule again.

When blocked, the control variable shall	<ul style="list-style-type: none"> • <u>not be sent</u> • send a specific value
Value (in %) <i>(if a value is sent)</i>	<u>0</u> ...100

In case of a common control variable for heating and cooling, 0 is always transmitted as a fixed value.

5.6. Variable comparator

The two integrated control variable comparators can output maximum, minimum and median values.

Use comparator 1/2	<u>No</u> • Yes
--------------------	-----------------

5.6.1. Control variable comparator 1/2

Determine what the control variable comparator should output, and activate the input objects to be used. Send behaviour and blocks can also be set.

Output delivered	<ul style="list-style-type: none"> • Maximum value • Minimum value • <u>Average value</u>
Use input 1/2/3/4/5	No • Yes
Output sends	<ul style="list-style-type: none"> • <u>on change of output</u> • on change of output and periodically • when receiving an input object • when receiving an input object and periodically
From change of <i>(is only sent if "on change" is selected)</i>	<u>1%</u> • 2% • 5% • 10% • 20% • 25%

Send cycle <i>(is only sent if "periodically" is selected)</i>	5 s • 10 s • 30 s • ... • <u>5 min</u> • ... • 2 h
Analysis of the blocking object	<ul style="list-style-type: none"> • <u>at value 1: block</u> <u>at value 0: release</u> • <u>at value 0: block</u> <u>at value 1: release</u>
Blocking object value before 1st communication	0 • 1
Behaviour of the switching output	
With blocking	<ul style="list-style-type: none"> • <u>do not send message</u> • Send value
Sent value in %	0 ... 100

5.7. Logic

The device has 16 logic inputs, four AND- and four OR-logic gates.

Activate the logic inputs and assign object values up to 1st communication. Then, activate the required logic outputs.

Use logic inputs	Yes • <u>No</u>
Object value before 1st communication for	
- Logic input 1	<u>0</u> • 1
- Logic input ...	<u>0</u> • 1
- Logic input 16	<u>0</u> • 1

Activate the required logic outputs.

AND logic

AND logic 1	<u>not active</u> • active
AND logic ...	<u>not active</u> • active
AND logic 4	<u>not active</u> • active

OR logic

OR logic 1	<u>not active</u> • active
OR logic ...	<u>not active</u> • active
OR logic 4	<u>not active</u> • active

5.7.1. AND logic 1-4 and OR logic outputs 1-4

The same setting options are available for AND and OR logic.

Each logic output may transmit one 1 bit or two 8 bit objects. Determine what the output should send if logic = 1 and = 0.

1. / 2. / 3. / 4. Input	<ul style="list-style-type: none"> • <u>do not use</u> - Logic inputs 1...16 - Logic inputs 1...16 inverted • all switching events that the device provides (see <i>Connection inputs of the AND/OR logic</i>)
Output type	<ul style="list-style-type: none"> • a <u>1-Bit-object</u> • two 8-bit objects

If the **output type is a 1-bit object**, set the output values for the various conditions.

Output value if logic = 1	<u>1</u> • 0
Output value if logic = 0	1 • <u>0</u>

If the **output type is two 8-bit objects**, set the type of object and the output values for the various conditions.

Object type	<ul style="list-style-type: none"> • Value (0...255) • Percent (0...100%) • Angle (0...360°) • Scene call-up (0...127)
Output value object A if logic = 1	0 ... 255 / 100% / 360° / 127; <u>1</u>
Output value object B if logic = 1	0 ... 255 / 100% / 360° / 127; <u>1</u>
Output value object A if logic = 0	0 ... 255 / 100% / 360° / 127; <u>0</u>
Output value object B if logic = 0	0 ... 255 / 100% / 360° / 127; <u>0</u>

Set the output send pattern.

Send pattern	<ul style="list-style-type: none"> • <u>on change of logic</u> • on change of logic to 1 • on change of logic to 0 • on change of logic and periodically • on change of logic to 1 and periodically • on change of logic to 0 and periodically • on change of logic+object receipt • on change of logic+object receipt and periodically
Send cycle (if sent periodically)	5 s • <u>10</u> s • ... • 2 h

Block

If necessary, activate the block for the logic output and set what a 1 or 0 at the block input means and what happens in the event of a block.

Analysis of the blocking object	<ul style="list-style-type: none"> • <u>At value 1: block</u> <u>At value 0: release</u> • <u>At value 0: block</u> <u>At value 1: release</u>
Blocking object value before first call	<u>0</u> • 1
Behaviour of switching output	
On block	<ul style="list-style-type: none"> • <u>Do not send message</u> • <u>Transmit block value</u> [see above, Output value if blocking active]
On release (with 2 seconds release delay)	[send value for current logic status]

5.7.2. Connection inputs of the AND logic

do not use

Logic input 1

Logic input 1 inverted

Logic input 2

Logic input 2 inverted

Logic input 3

Logic input 3 inverted

Logic input 4

Logic input 4 inverted

Logic input 5

Logic input 5 inverted

Logic input 6

Logic input 6 inverted

Logic input 7

Logic input 7 inverted

Logic input 8

Logic input 8 inverted

Logic input 9

Logic input 9 inverted

Logic input 10

Logic input 10 inverted

Logic input 11

Logic input 11 inverted

Logic input 12

Logic input 12 inverted

Logic input 13

Logic input 13 inverted

Logic input 14

Logic input 14 inverted

Logic input 15

Logic input 15 inverted

Logic input 16
Logic input 16 inverted
Temperature sensor malfunction = ON
Temperature sensor malfunction = OFF
Switching output temperature 1
Switching output temperature 1 inverted
Switching output temperature 2
Switching output temperature 2 inverted
Switching output temperature 3
Switching output temperature 3 inverted
Comfort temperature controller active
Comfort temperature controller inactive
Eco temperature controller active
Eco temperature controller inactive
Standby temperature controller active
Standby temperature controller inactive
Temperatur controller frost/heat active
Temperatur controller frost/heat inactive
Temp. control status heating 1
Temp. control status heating 1 inverted
Temp. control status heating 2
Temp. control status heating 2 inverted
Temp. control status cooling 1
Temp. control status cooling 1 inverted
Temp. control status cooling 2
Temp. control status cooling 2 inverted

5.7.3. Connection inputs of the OR logic

The OR logic connection inputs correspond to those of the AND logic. In addition the following inputs are available for the OR logic:

AND logic 1
AND logic output 1 inverted
AND logic output 2
AND logic output 2 inverted
AND logic output 3
AND logic output 3 inverted
AND logic output 4
AND logic output 4 inverted

Questions about the product?

You can reach the technical service of Elsner Elektronik under
Tel. +49 (0) 70 33 / 30 945-250 or
service@elsner-elektronik.de

We need the following information to process your service request:

- Type of appliance (model name or item number)
- Description of the problem
- Serial number or software version
- Source of supply (dealer/installer who bought the device from Elsner Elektronik)

For questions about KNX functions:

- Version of the device application
- ETS version used for the project